





SYLFLOOD

Electrical Information

- 1) The connection must be made in a permanent manner using a three conductor heat resistant cable in accordance with local regulations.
- 2) The connection must be performed by a qualified electrician in line with local regulations.
- 3) Loosen the four gear housing screws and remove the cover.
- 4) Insert the cable into the gear housing via the cable gland. NOTE: The cable gland is suitable for cable from 8 – 13 mm OD. Use circular cable with 2 cores plus earth.
- 5) Connect the phase (L or brown or red), neutral (N or blue or black) and earthing wire (yellow/green) to the marked terminals.
- 6) Retighten four screws on the gear housing.
- 7) Tighten the cable gland.

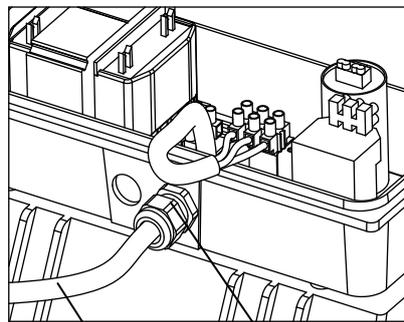


Cable gland
 Mains supply
 Ø8.0mm or Ø13mm flex

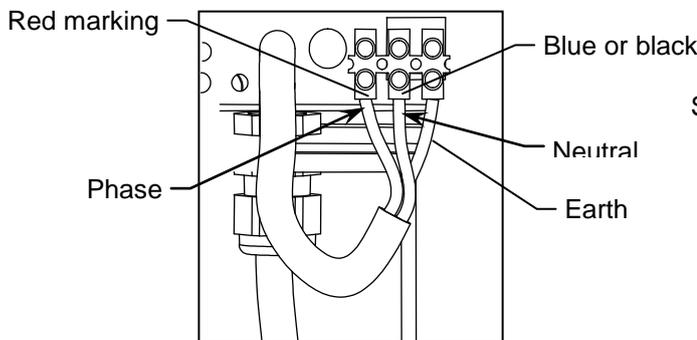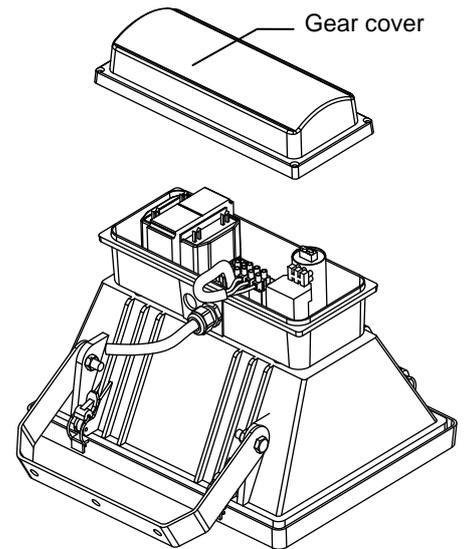

Fitting Lamps

1. Before opening, disconnect the floodlight from the mains supply
2. Open front door by unclasp ing latches at the top.
3. Screw lamp into lamp holder and close front door

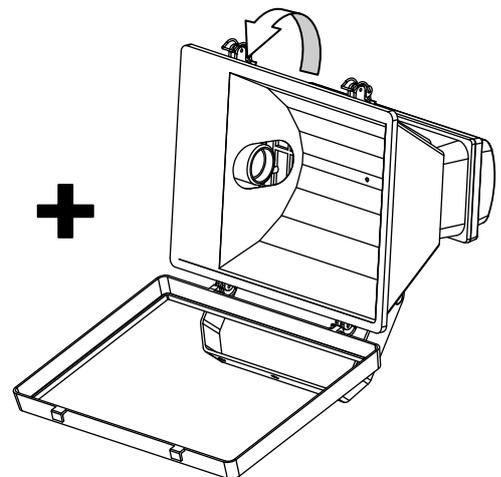

This product must be installed by a qualified electrician.

Victoria
 Ph: (03) 9689 7833
 Fax: (03) 9689 5611

New South Wales
 Ph: (02) 8873 0000
 Fax: (02) 9888 7294

Queensland
 Ph: (07) 3034 8600
 Fax: (07) 3846 3689

South Australia
 Ph: (08) 8354 2122
 Fax: 1800 648 641

Western Australia
 Ph: (08) 9478 1399
 Fax: (08) 9277 1119

New Zealand
 Ph: +64 9828 3113
 Fax: +64 9828 7426

Head Office
 Ph: (02) 4328 0600
 Fax: (02) 4328 2605

This product has been manufactured under SLA's ISO9000 Quality and ISO14001 Environmental Management Systems
 QA controls this electronic document. Printed copies are uncontrolled and will not be updated automatically.

Code: Z45023 SYLFLOOD Issue 1 Rev 1